

Automation upgrade

LTR-3 ECC -> eWind

Warning!

According to regulations, an ordinary electricity consumer is only allowed to perform some minor service tasks.

**According to Finnish regulations,
a list of the allowed tasks can be found at the Tukes home page (www.tukes.fi).**

Always make sure that the power supply is turned off before opening the service door.

Wait two minutes before beginning the maintenance work. The fans rotate for some time by themselves, and the heating element may be hot even if the power supply of the ventilation unit is switched off. Electrical housing may be opened only by a trained electrician.

Electrical installations must comply with local regulations.

**Continuously check and compare the electrical diagrams at the end
of this instruction as the upgrade progresses!**

Table of contents

Upgrade.....3


Electrical diagrams ECC33

Electrical diagrams eWind35


Parts list eWind E39

Notes40

Remove **the service door (1)** by releasing the locks.

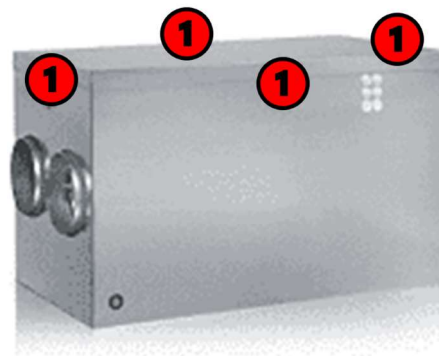


Cut **the power to the unit (2)** (and other power supplies if available).



Remove **the cover to the electrical box (3)**.

NOTE! Ensure that no voltage is occurring in the electrical box before proceeding!



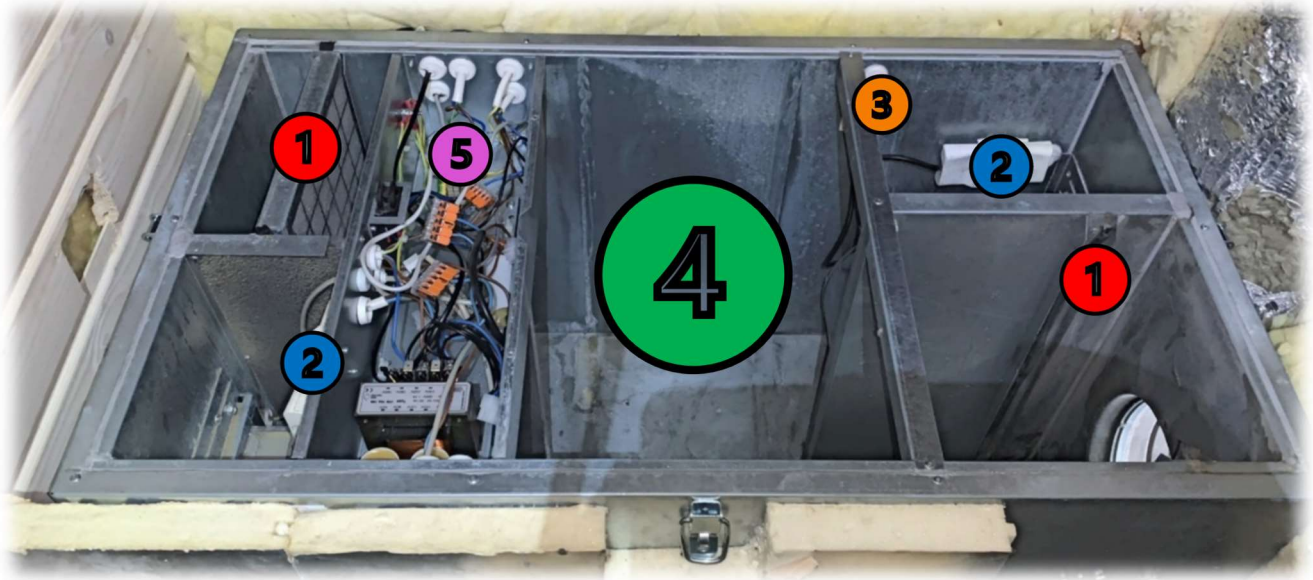


Remove **the filters (1)** by pulling.

Disconnect **the fan connectors (2)**.


Disconnect **the HRW connector (3)**.

Remove **the HRW (4)** by pulling.


Disconnect the main switch power wires from **the terminals (5)**.

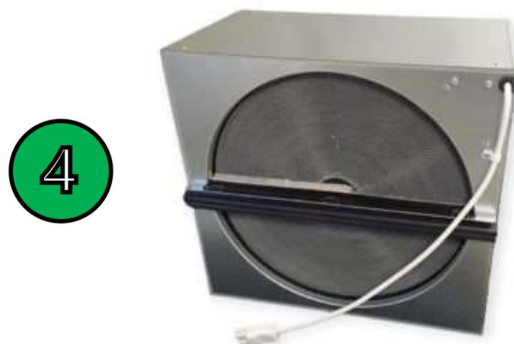


Remove **the supply air fan (1)**
by releasing **the screws (2)**.

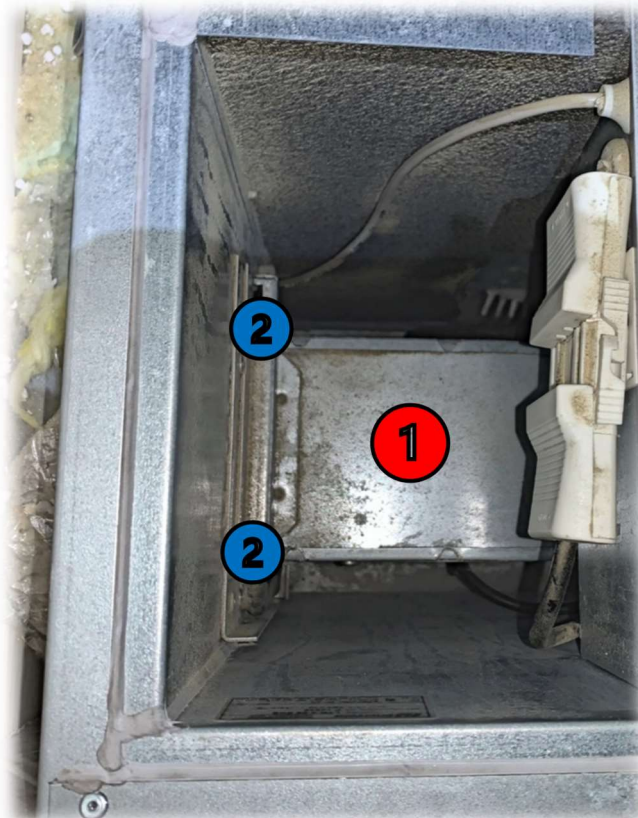


Remove **the extract air fan (3)**
by releasing **the screws (4)**.

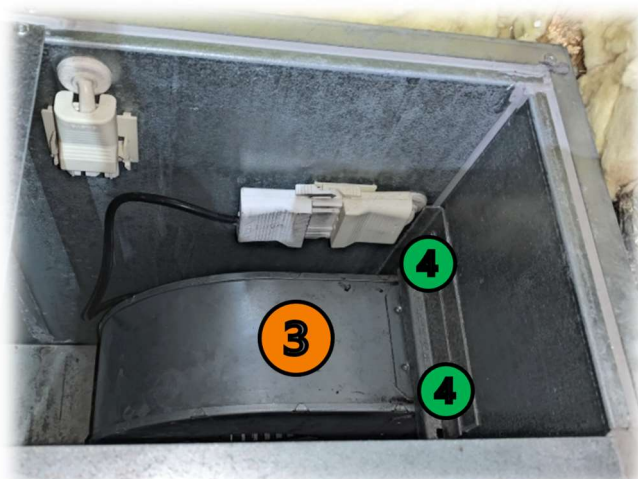

Remove **the main switch (1)** by pressing **the clips (2)**.
Disconnect **the wires (3)** from the main switch.

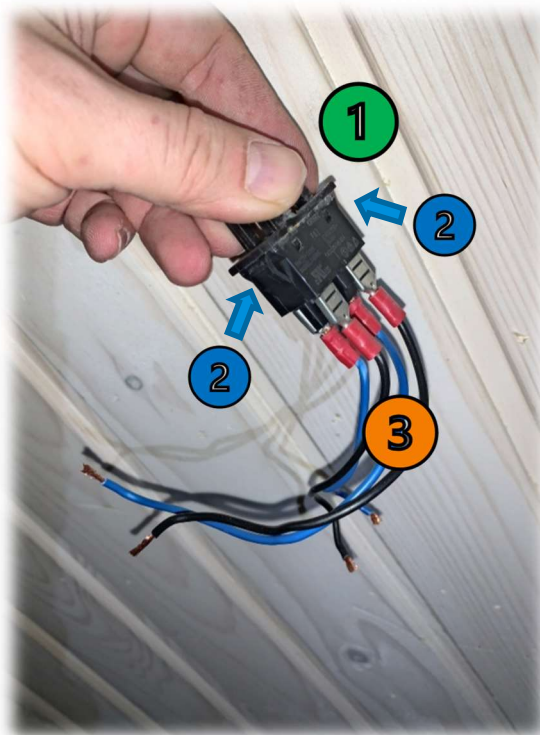


Disconnect **the main power wires (4)**.
Disconnect and remove **the main switch wires (5)**.

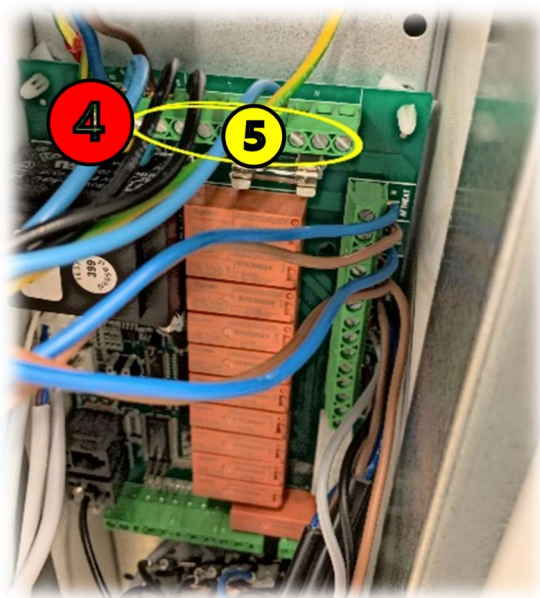


Disconnect **all ground wires (1)** from the ground point.

Disconnect the main power wires from **the terminals (2)**.

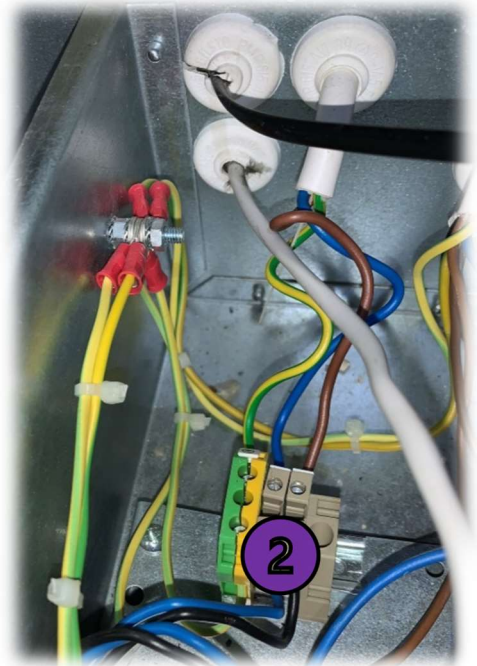

Disconnect **the wires (3)**.

Disconnect **the connector (4)**.

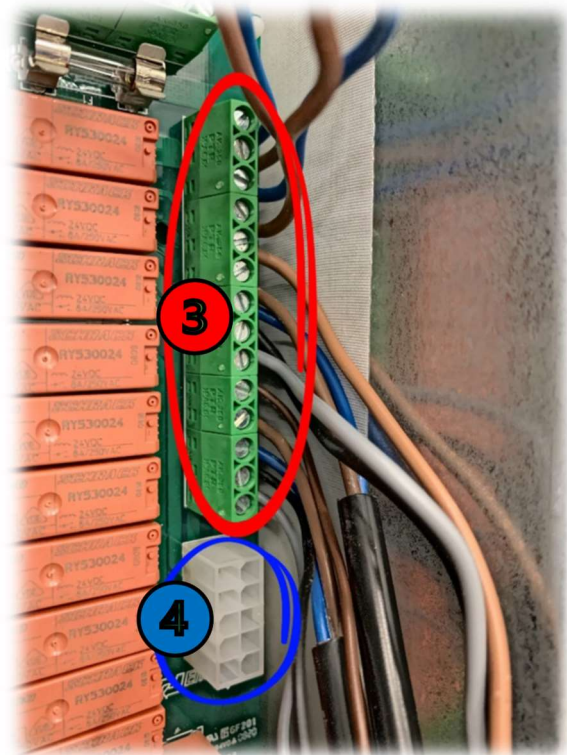



Disconnect **the sensors (1)**.

Disconnect **the connector (2)**.

Disconnect **the display cable (3)**.

If there are wires connected **here (4)**, mark them according to the reading on the main board and disconnect.

Remove **the screws (5)** and remove the automation base incl. **main board (6)**, **capacitors (7)** and **transformer (8)**.

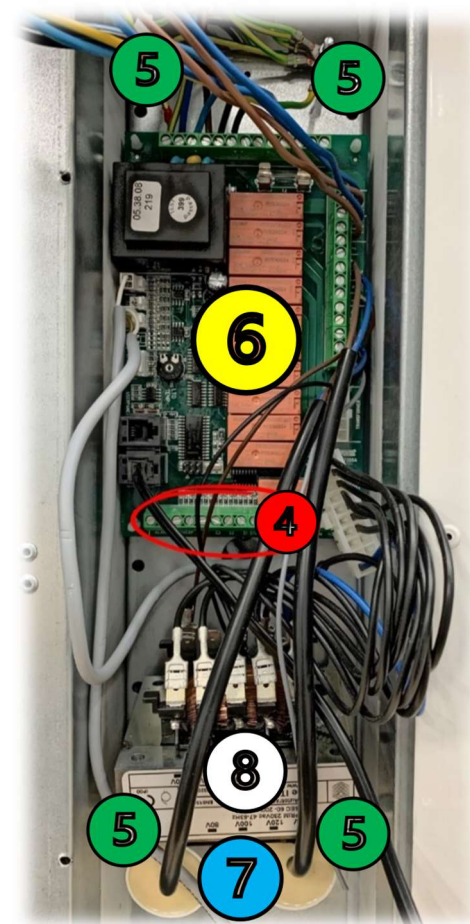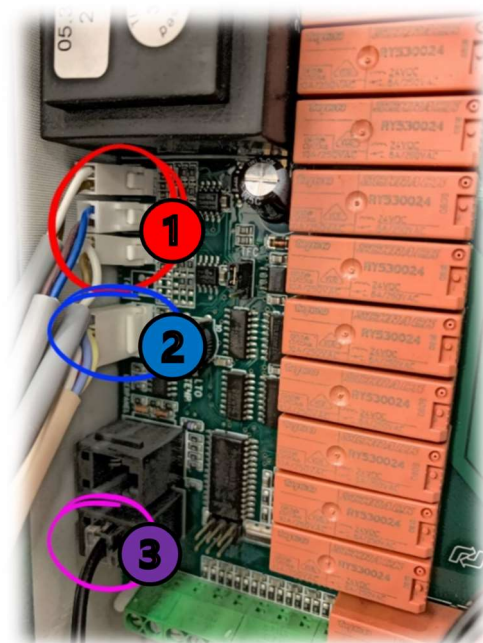

Remove **the supply air sensor (1)**.
Ignore if no after heater installed.


Remove **the supply air fan cable (2)**.



Remove **the HRW supply air sensor (3)**.



Remove **the after heater and the cables (1)**
by releasing **the five screws (2)**.
Ignore if no electrical after heater installed.

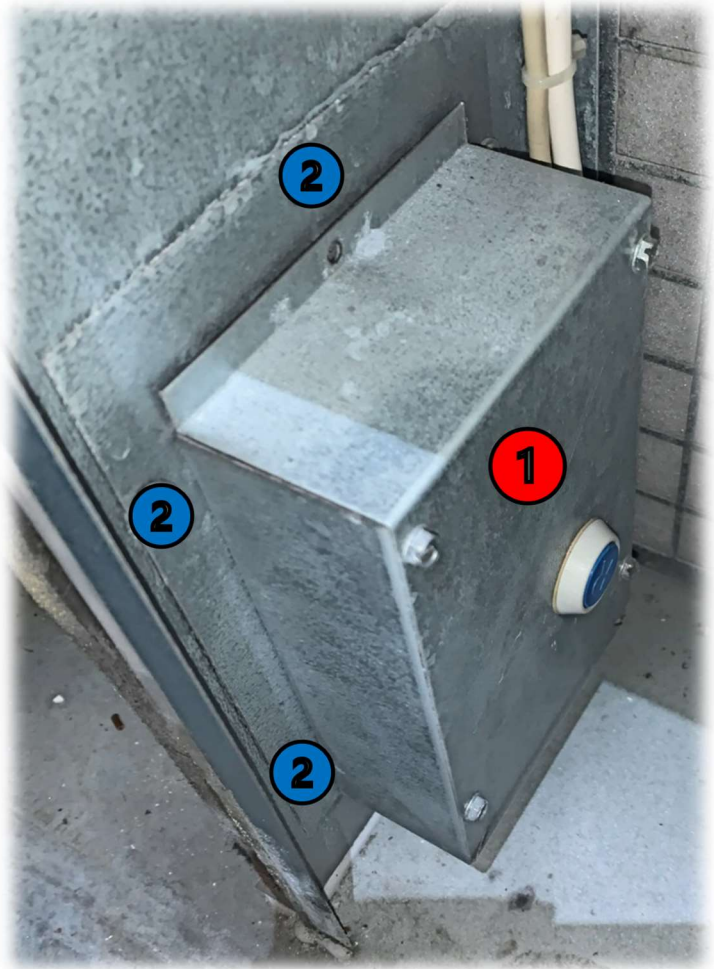

Release **the outside air sensor (3)**.

Remove **the cable sealings (4)**.





Attach **the new sensors (1)** (40029167) to **the old sensors (2)** with strong tape.

Mark the new sensors in both ends:


"TE01" (outside air)

"TE32" (waste air)



Remove **the cable sealings (1)**.

Install **the new sensors (1700mm) (40029167)**
into the electrical box (2).

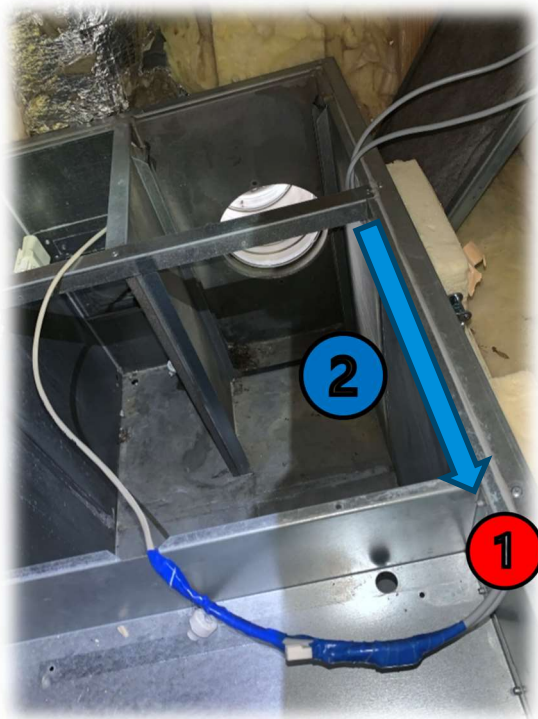

Install **new cable sealings (3) (40030100)**.



Install **new cable sealings (1)** (40030100).

Attach the sensors to the frame with **cable ties (2)** (40030997).



Install **the new HRW supply air sensor (850mm) (3)** (40029165).

Mark the sensor:
"TE05" (HRW supply air)



Install **the new supply air sensor (850mm) (4)** (40029165).

Mark the sensor:
"TE10" (supply air)





Remove **the cable sealing (1)**.

Cut **the old HRW cable (3)**.

Install **a new cable sealing (40029244)**
to the new HRW cable (2) (40033952).

Attach **the new HRW cable (2)**
(40033952) to **the old HRW cable (3)**
with strong tape.

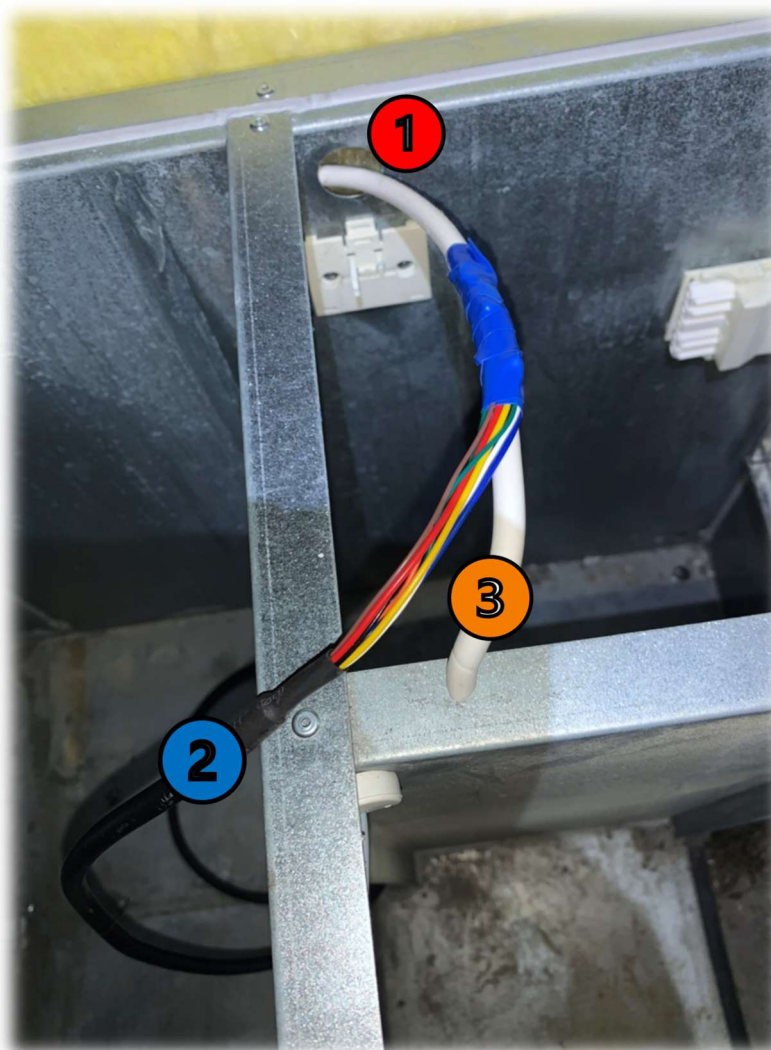

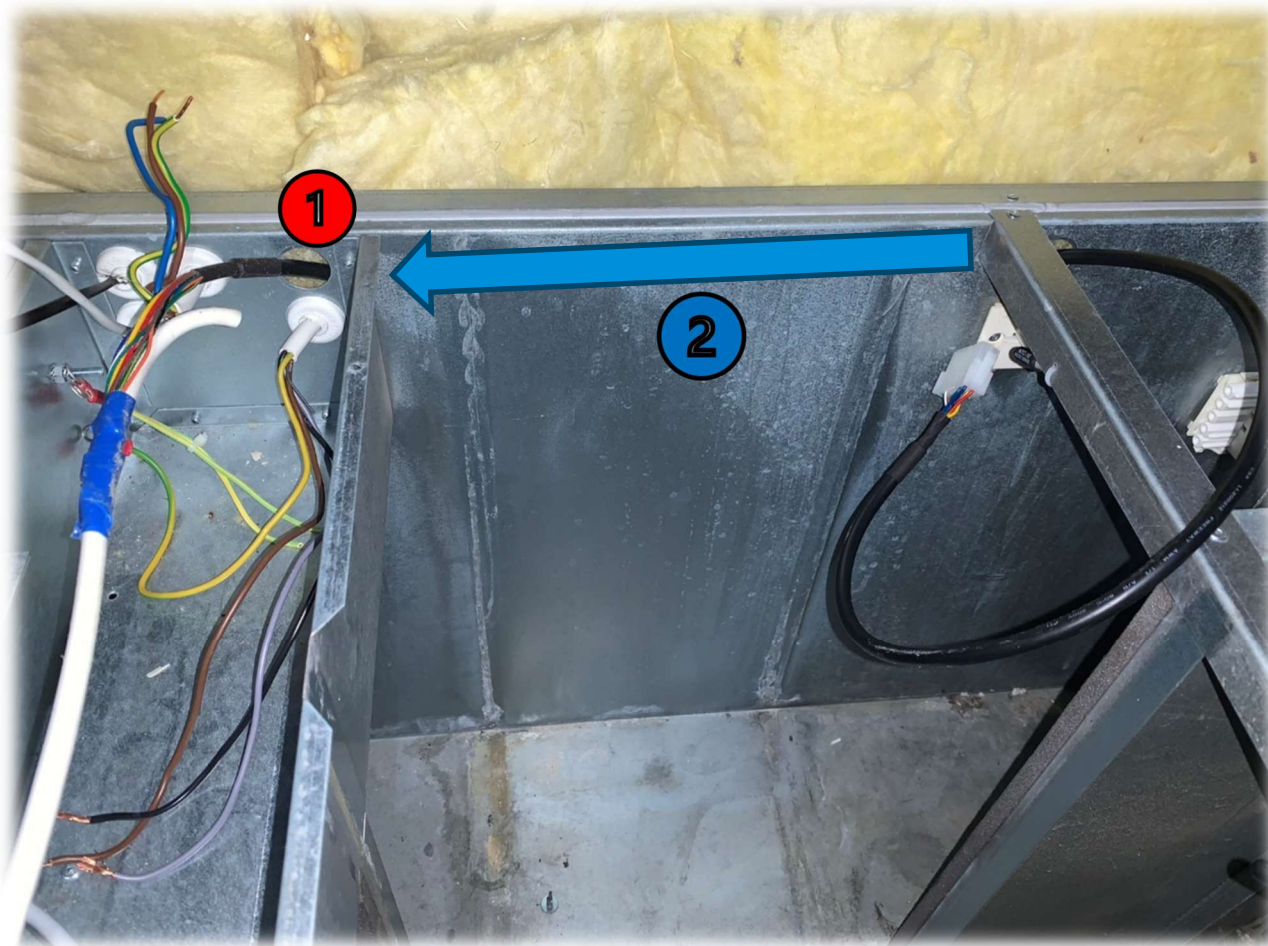

Remove **the cable sealing (1)**.

Install **the new HRW cable (40033952) to the electrical box (2)**.

Install **a new cable sealing (1) (40029244)**.



Remove **the cable sealing (1)**.

Cut **the old extract air fan cable (3)**.

Install **a new cable sealing (40029244) to the new extract air fan cables (2) (40028803, 40028802)**.

Attach **the new extract air fan cables (2) (40028803, 40028802)**
to **the old extract air fan cable (3)** with strong tape.



Remove **the cable sealing (1)**.


Install **the new extract air fan cables (2)** (40028803, 40028802) **to the electrical box (2)**.

Install **a new cable sealing (1)** (40029244).




New cables installed.

Install **the new supply air fan cables (1)** (40028782, 40028784) to the electrical box.

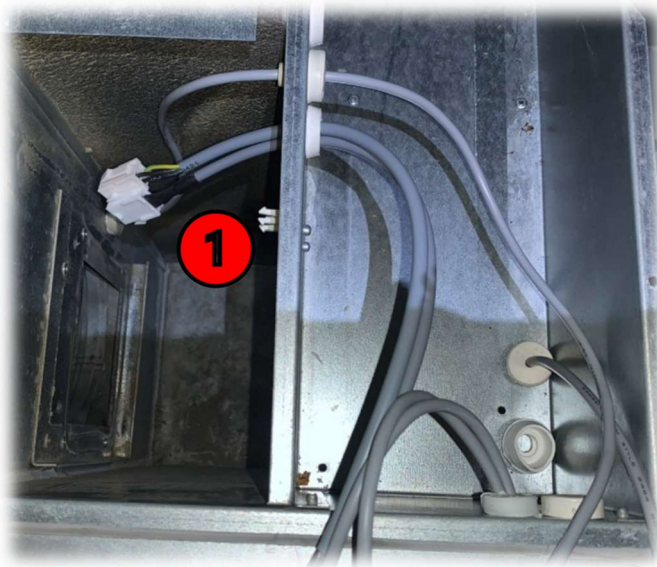

Install **the new electrical after heater (2)** (10023290) and install the cables to the electrical box.


Install **the new extract air sensor (3)** (40029223) in the extract air chamber through a cable sealing in the electrical box and attach it to the after heater cables with a cable tie.

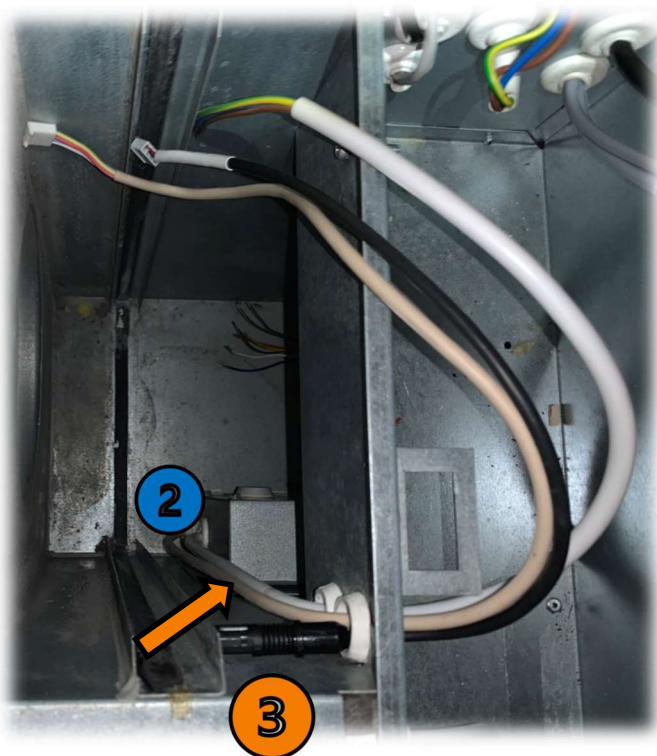

Install **the new automation base** (40029647) in the electrical box.

Make sure no installed cable / sensor get stuck behind the automation base and that they are available in front of the main board.

Attach **the new automation base** (40029647) to the electrical box with **four self tapping screws (1)** (40031530).

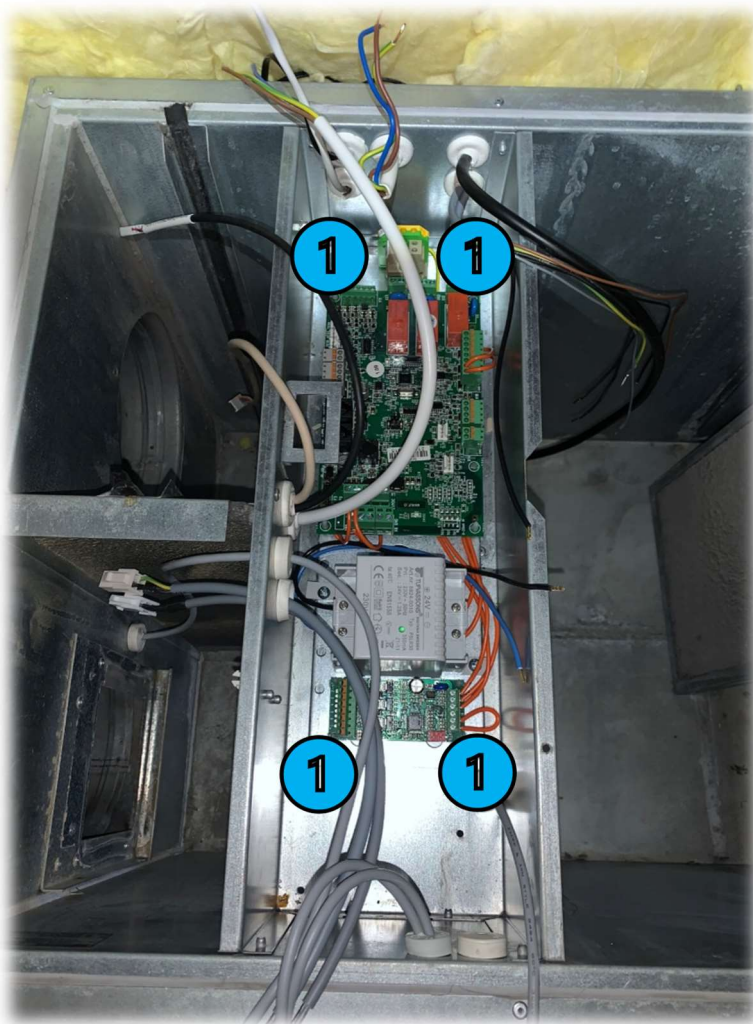


Connect **the main power wires to the terminals (2)**.


L: Brown

PE: Green/yellow

N: Blue

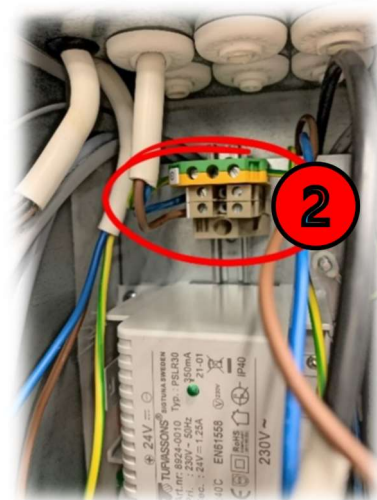


Connect **all ground wires** to **the ground point (1)**.
Supply air fan, extract air fan, after heater, (HRW), ground terminal.
 Tighten with **the nut (40031489)**.

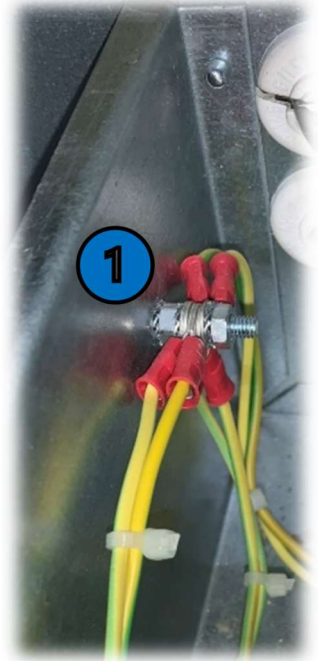


Install **the connection terminals (2)** (40029982).
 One for "L" and one for "N".




Connect one pair of **the wires with flat connectors** (40028776, 40028777) **to the connection terminals (1)** (40029982).

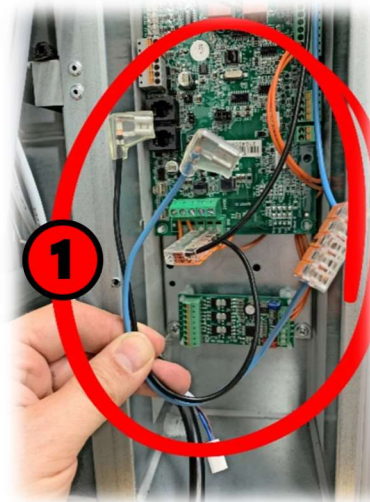

Connect **the blue wire** from the electrical after heater to **the blue connection terminal (2)** (40029982).

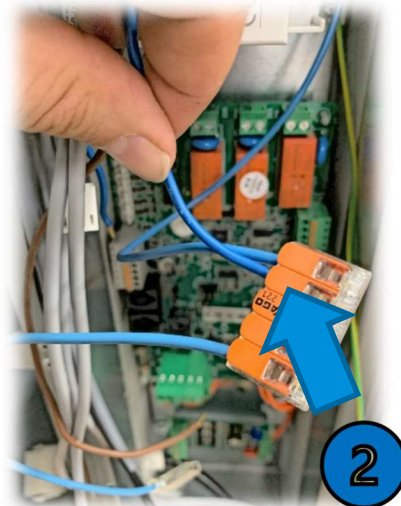

Connect **the black wire** (40028774) to **the black connection terminal (3)** (40029982).

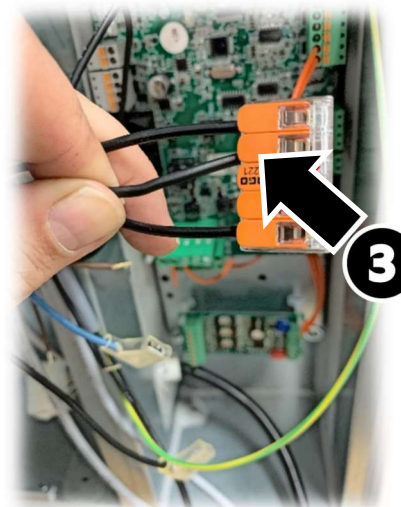


Connect **the black wire** (40028774) to **"DO2" (2)** on the main board.




Connect **the brown wire** from the electrical after heater to **"DO2" (2)**.




Connect **the wires marked "2"** in the fan power cables (40028782, 40028803) to **the blue connection terminal (2)** (40029982).

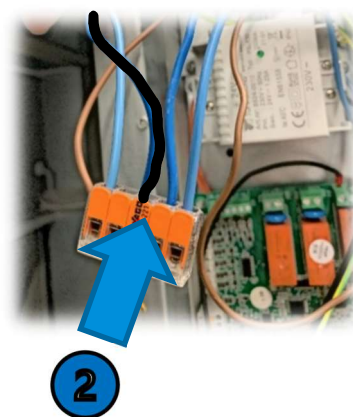

Connect **the wires marked "1"** in the fan power cables (40028782, 40028803) to **the black connection terminal (1)** (40029982).

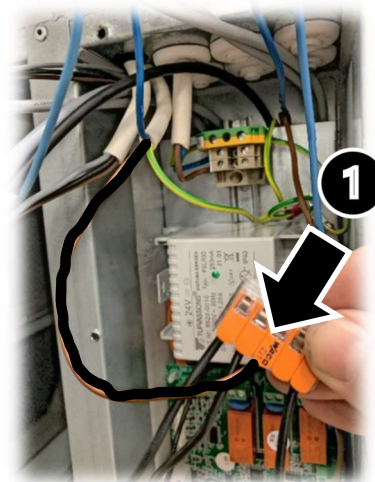


Connect **the extract air sensor (2)** (40029223) to the main board (X29).

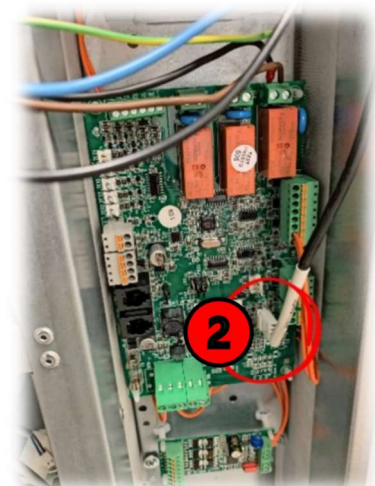

Connect **the sensors (3)** to the main board according to the markings.

TE01: Outside air (40029167)
TE05: HRW supply air (40029165)
TE10: Supply air (40029165)
TE32: Waste air (40029167)

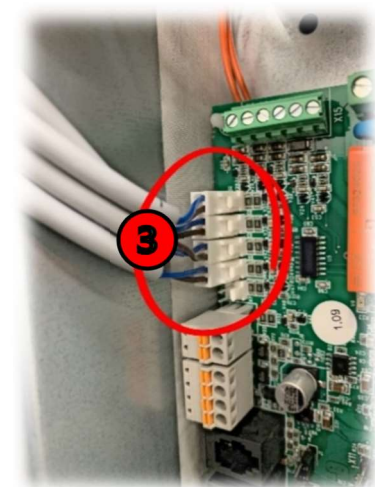


Connect **the wires from the supply air fan control cable (1)** (40028784) to the main board.

AO1: Brown

GND: Black

DI11: Gray

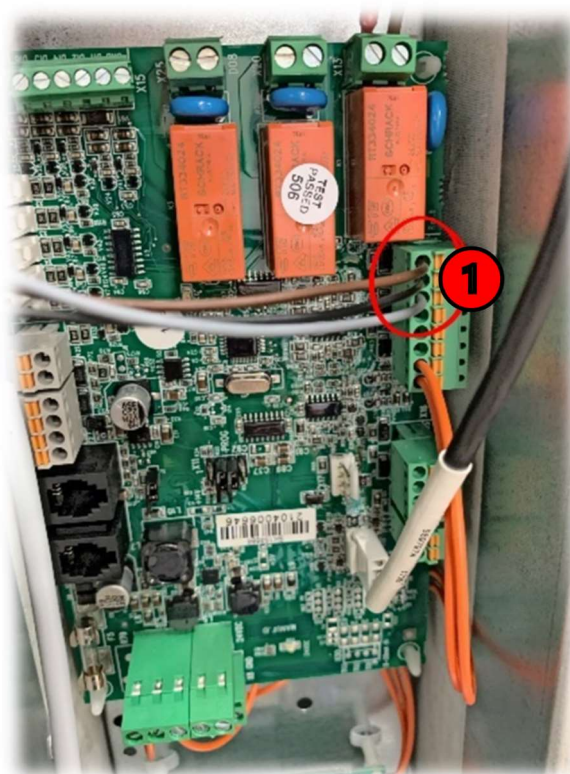


Connect **the wires from the extract air fan control cable (2)** (40028802) to the main board.


AO2: Brown

GND: Black


DI12: Gray

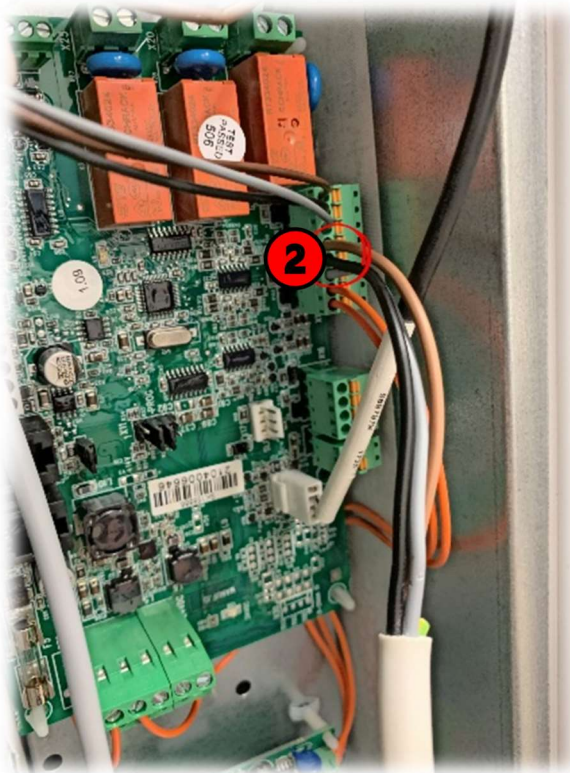

Release **the screw (1)** and attach **the ground wire (2)** from the HRW cable to the screw, along with **a washer**.

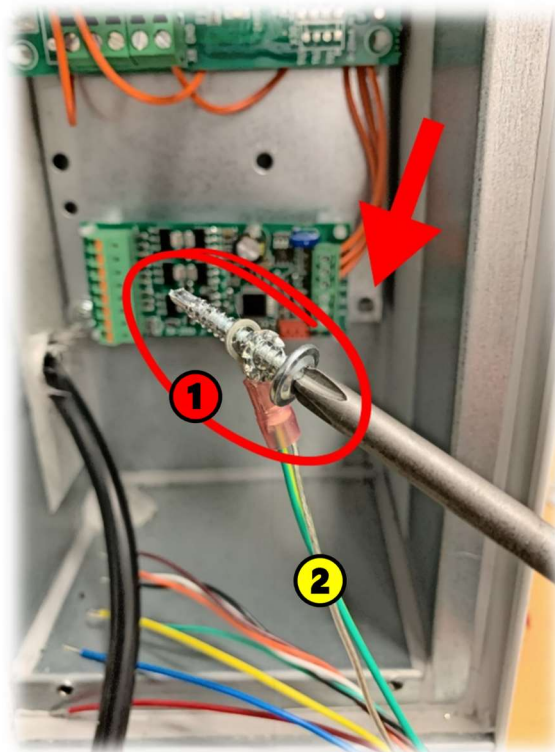

Reattach **the screw (3)** to the automation base.

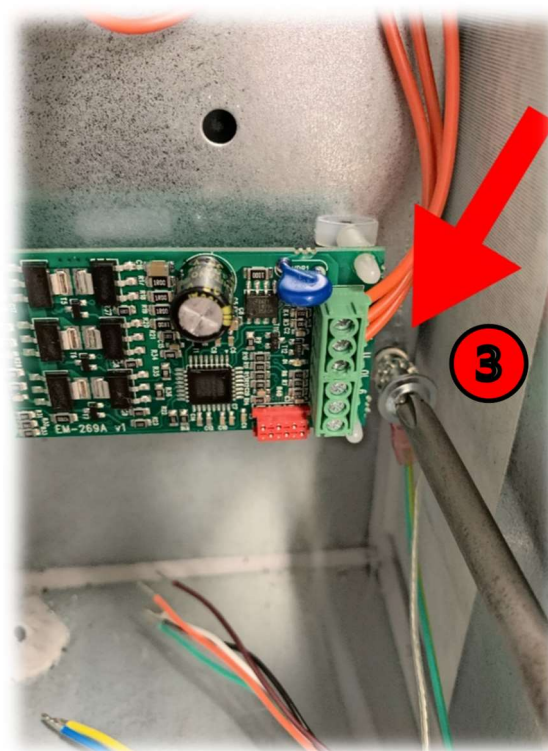

Connect **the wires from the HRW cable** (40033952) **to the HRW control board (1).**

1: Yellow

2: Red

3: Blue


4: White

5: Black

6: Brown


7: Green

8: Orange

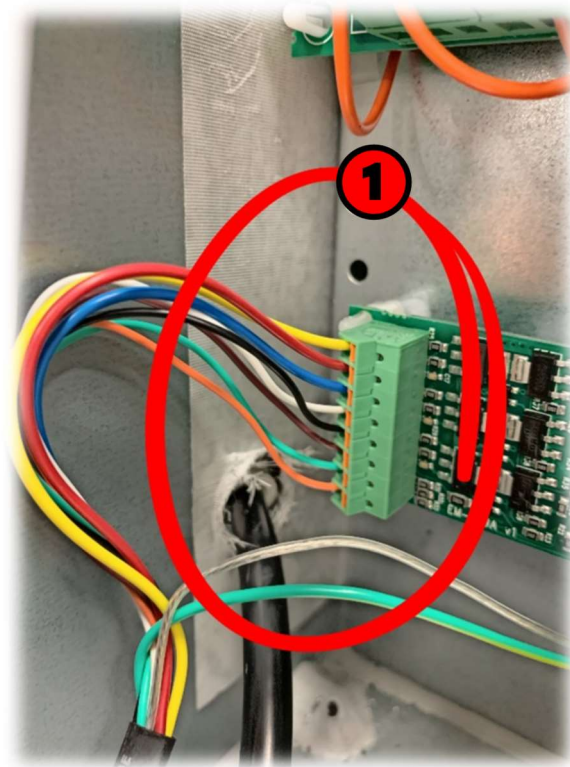

Connect **the after heater control cable (2)** to the main board (X17).

Connect other components according to the electrical diagrams (pages 35-38).

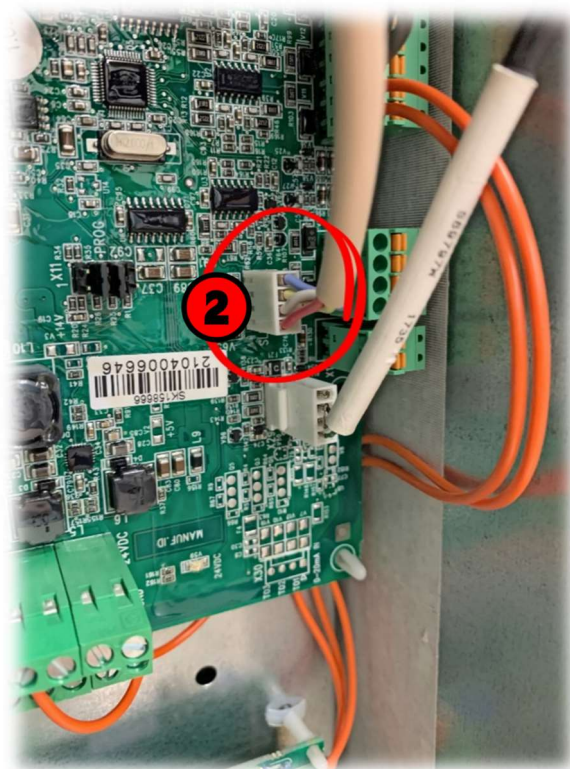



Connect the pairs of wires with flat connectors, (40028776, 40028777) to the **main switch (1)**, **install the main switch (5)** and connect **the wires (3 & 4)** to **the connection terminals (3 & 4)**.

L: Black (3)


N: Blue (3)


Black connection terminal: Black (4)

Blue connection terminal: Blue (4)

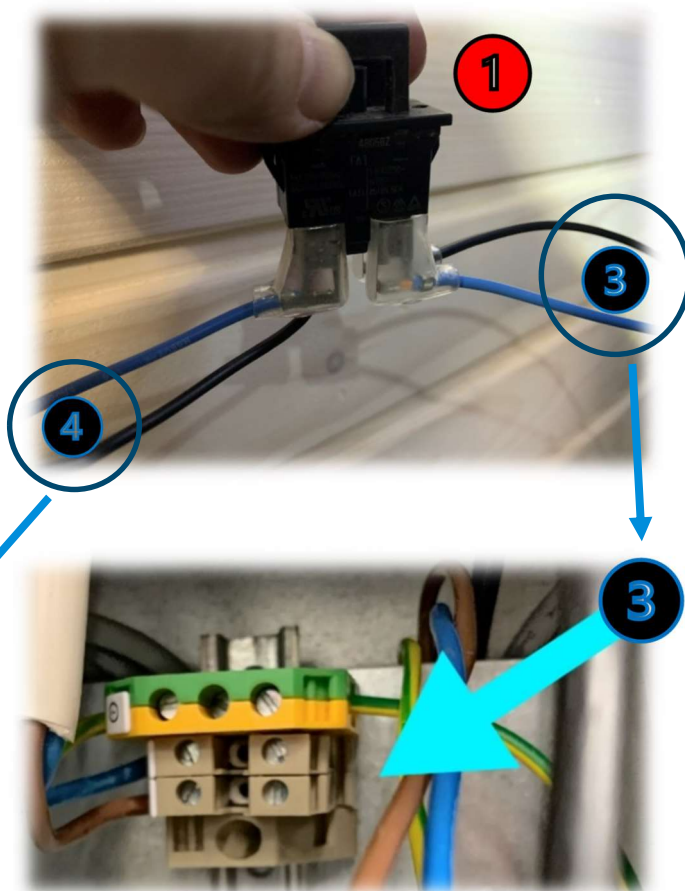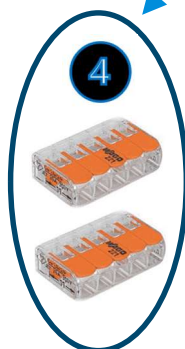

Attach the cables together with **cable ties (40030997)**.

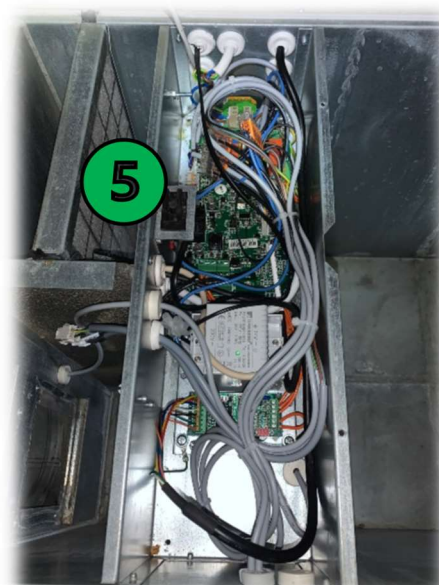

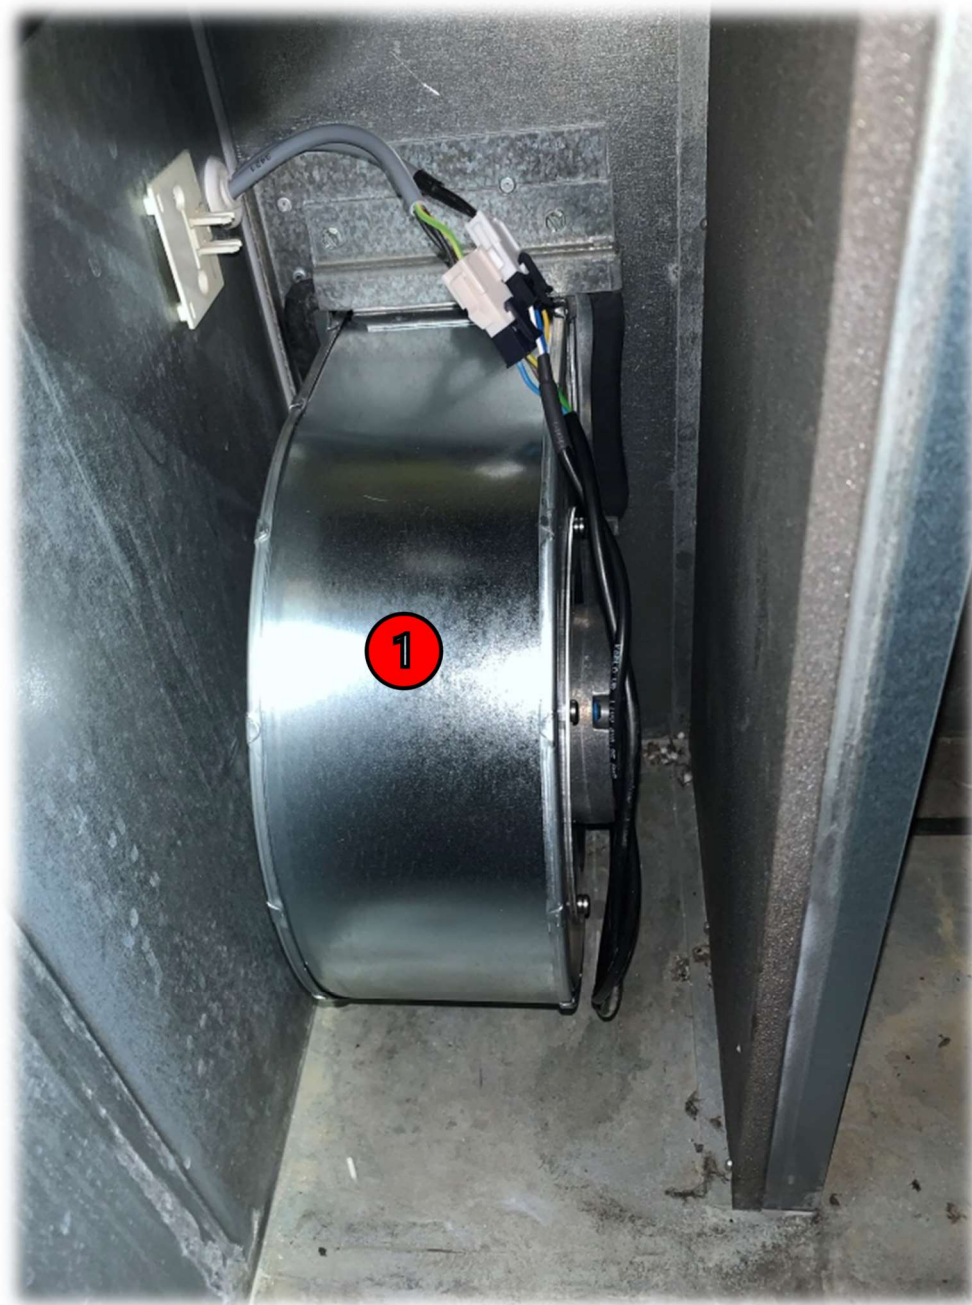


Install and connect **the new fans (1)** (10023157).


Remove **the screws (1)** from the HRW cover.



Remove **the belt (2)** from the wheel.
Remove **the screws (3)** from the motor package.
Remove **the ground wire (4)**.

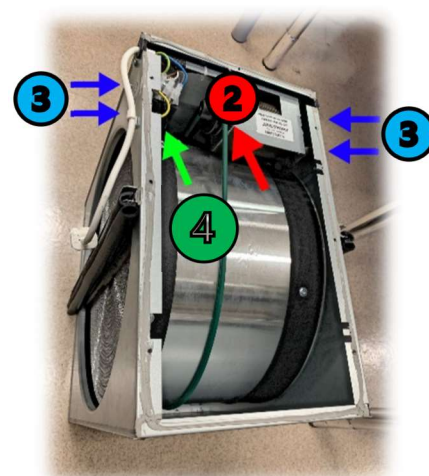


Remove **the motor package**.
Cut **a gap for the new motor cable (5)**.
Check that **the brush clips (6)** are in place.

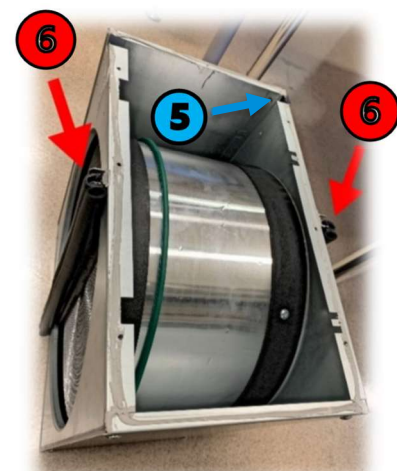


Install **the new motor package (2)** (40028737).
Check that **the brush clips (1)** are in place.

Install the HRW cover.

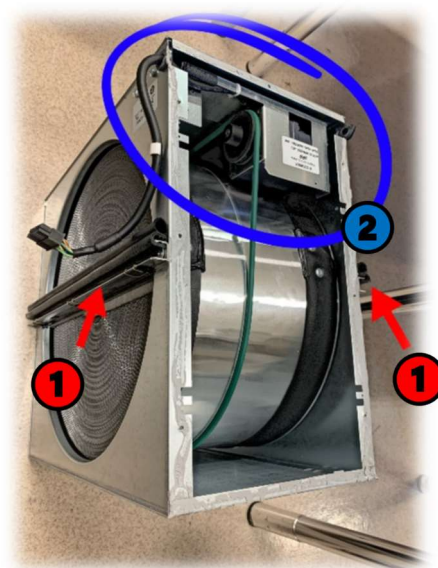

Connect **the display cable (3)** to the main board.
Close the cover to the electrical box.

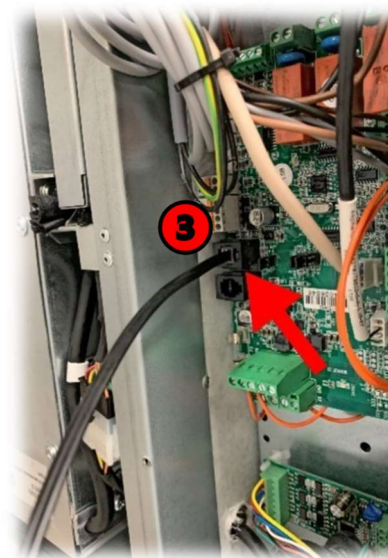

Replace the old display with **the new display (4)** (40031115).




Install **the WiFi module (1)** (40034288).




Install **the new type plate sticker (2)**.


Install and connect **the HRW (3)**.


Install **the filters (4)**.

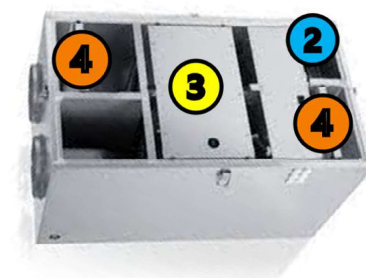

Press down **the main switch (5)** and perform insulation and ground continuity test according to regulations.

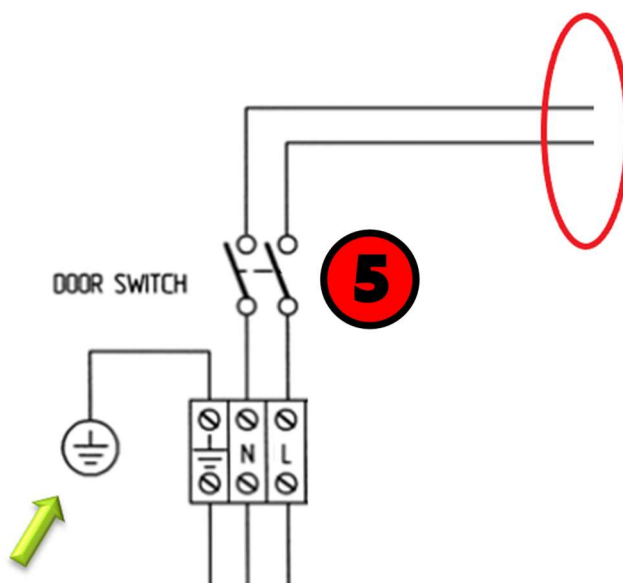


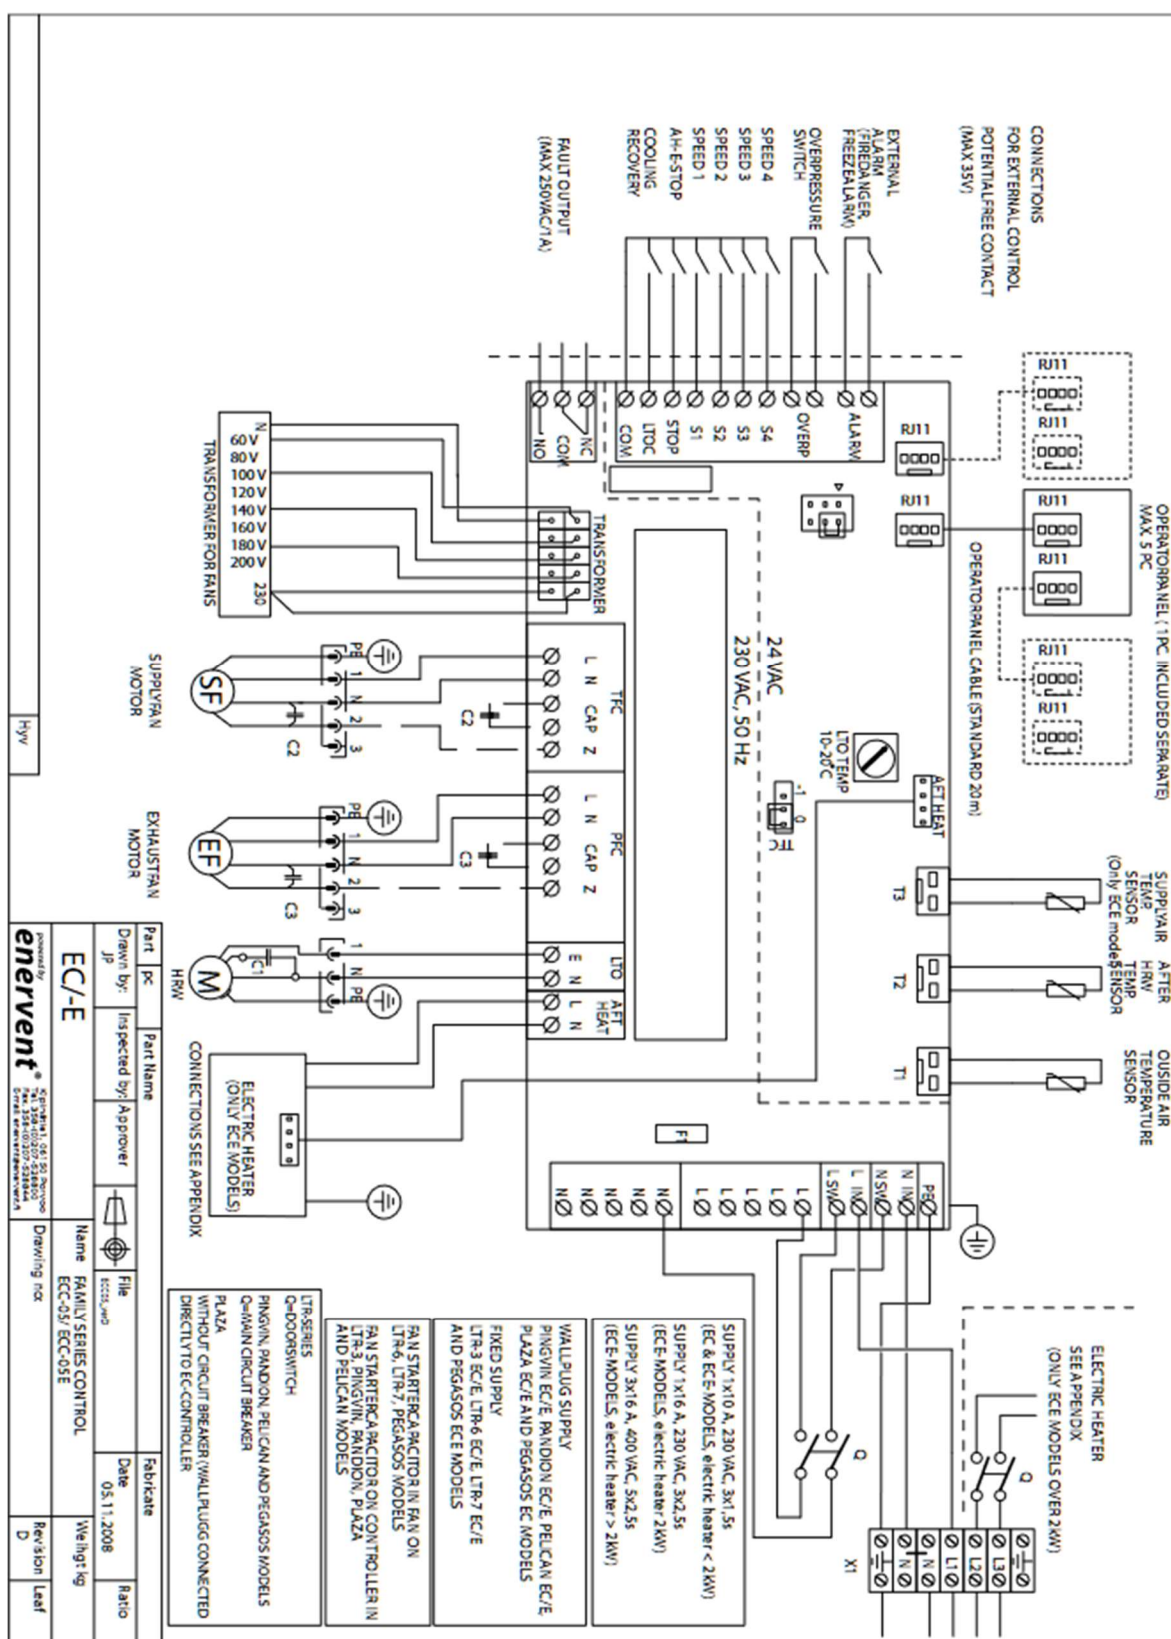


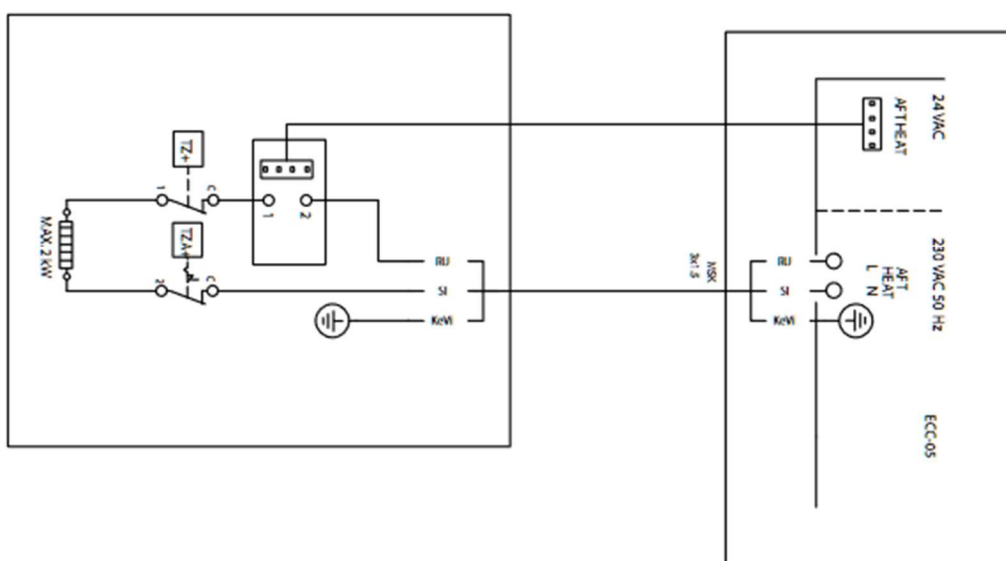



RJ=RUSKEA/BROWN
SI=SINENEN/BLA/BLE
Kevi=KELTAMH-REA/GULGRON/YELLOWGREEN

[illegible]

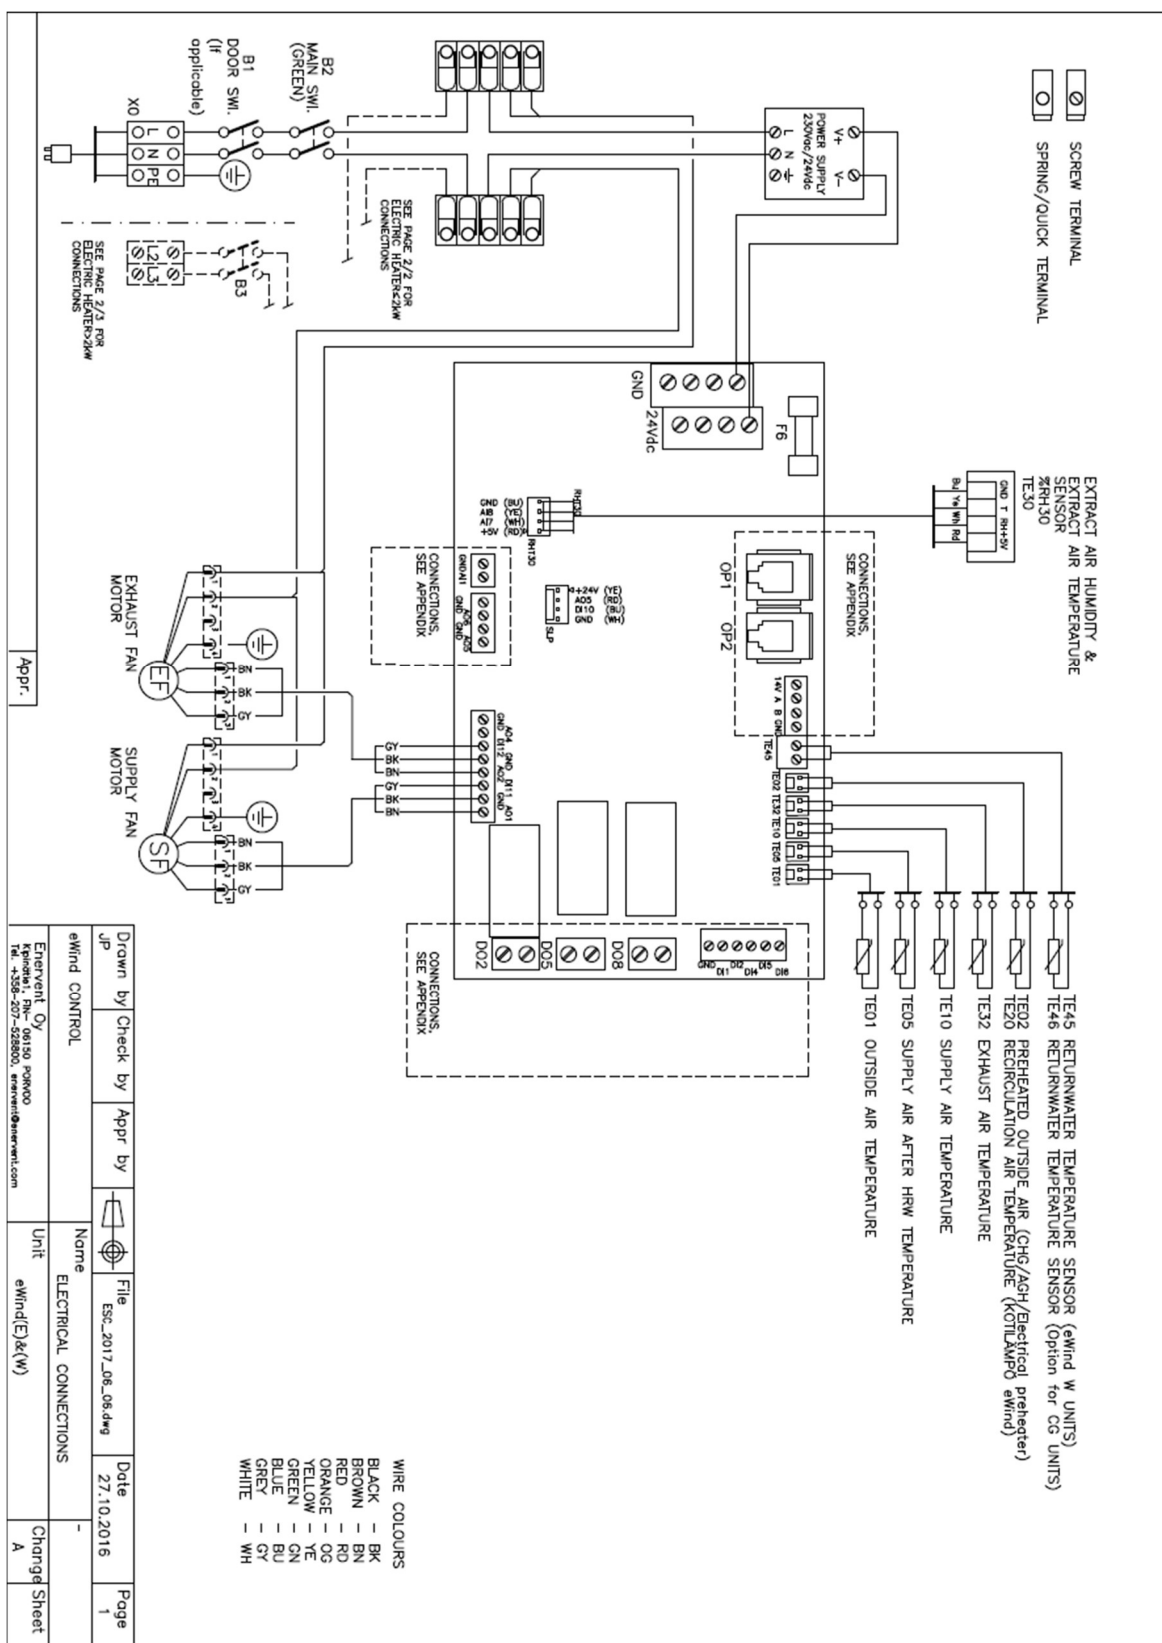

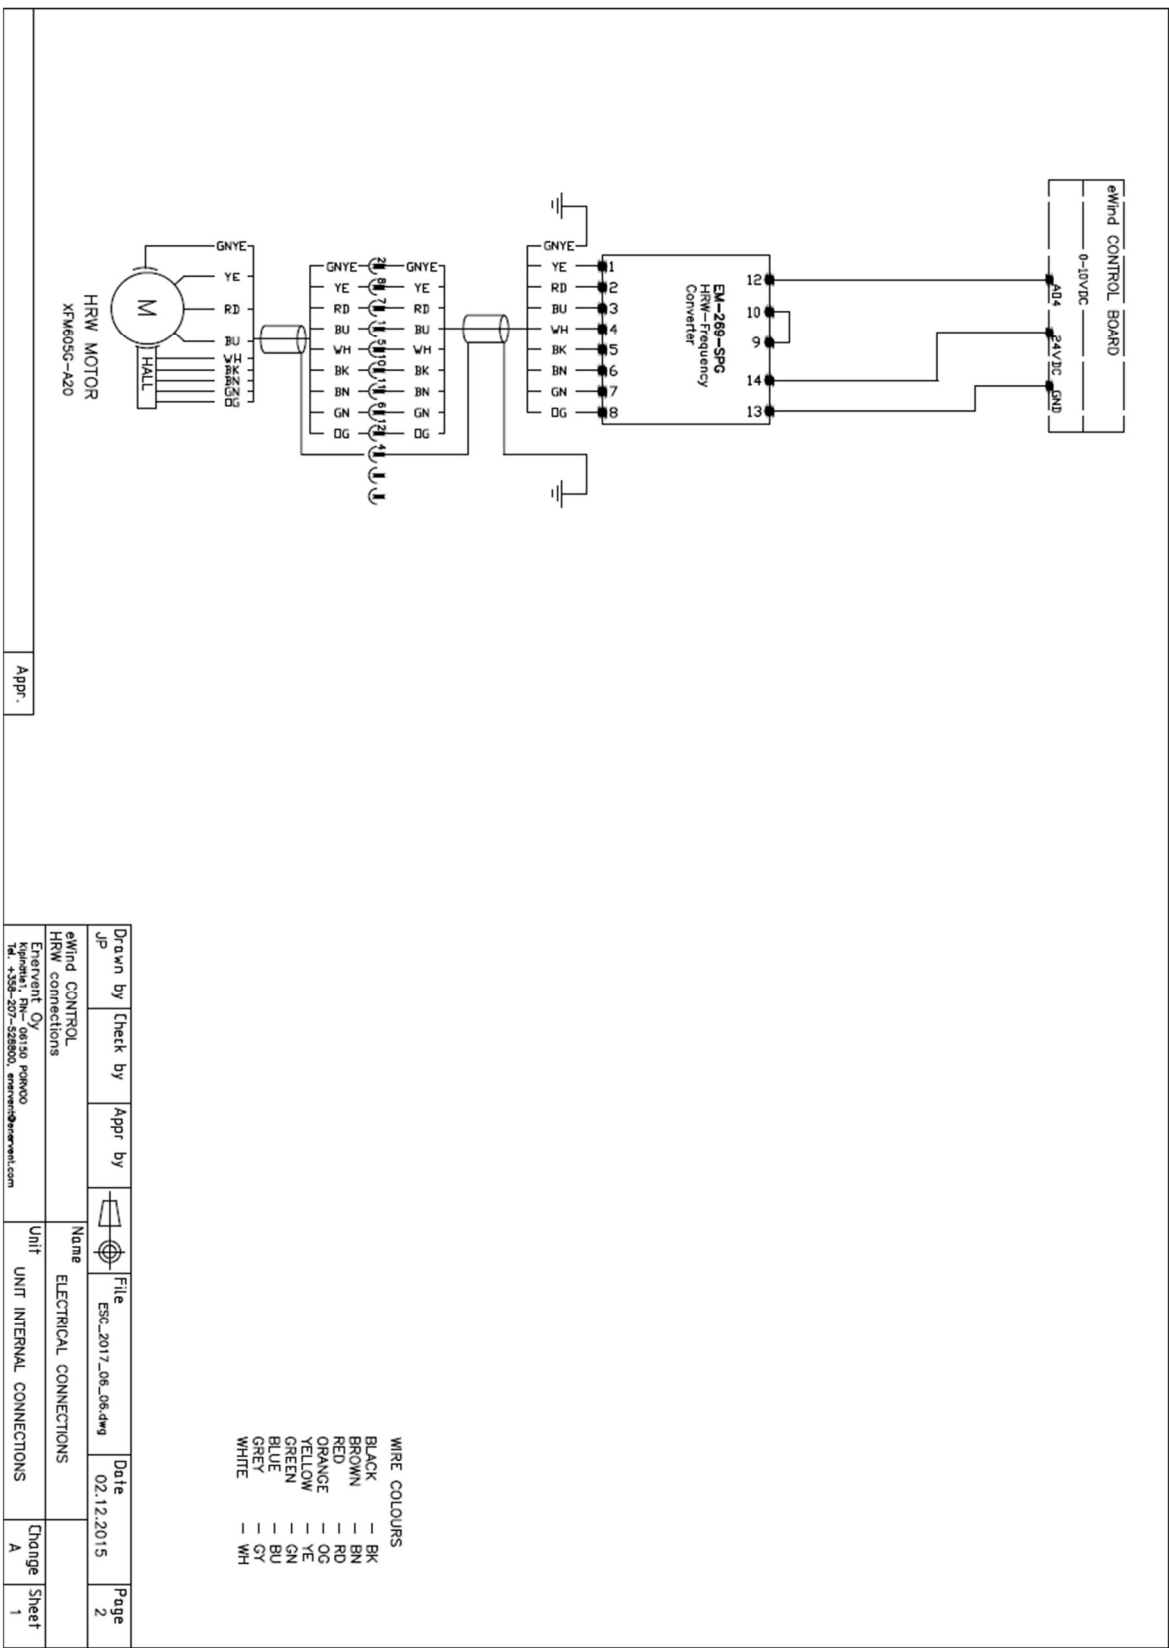

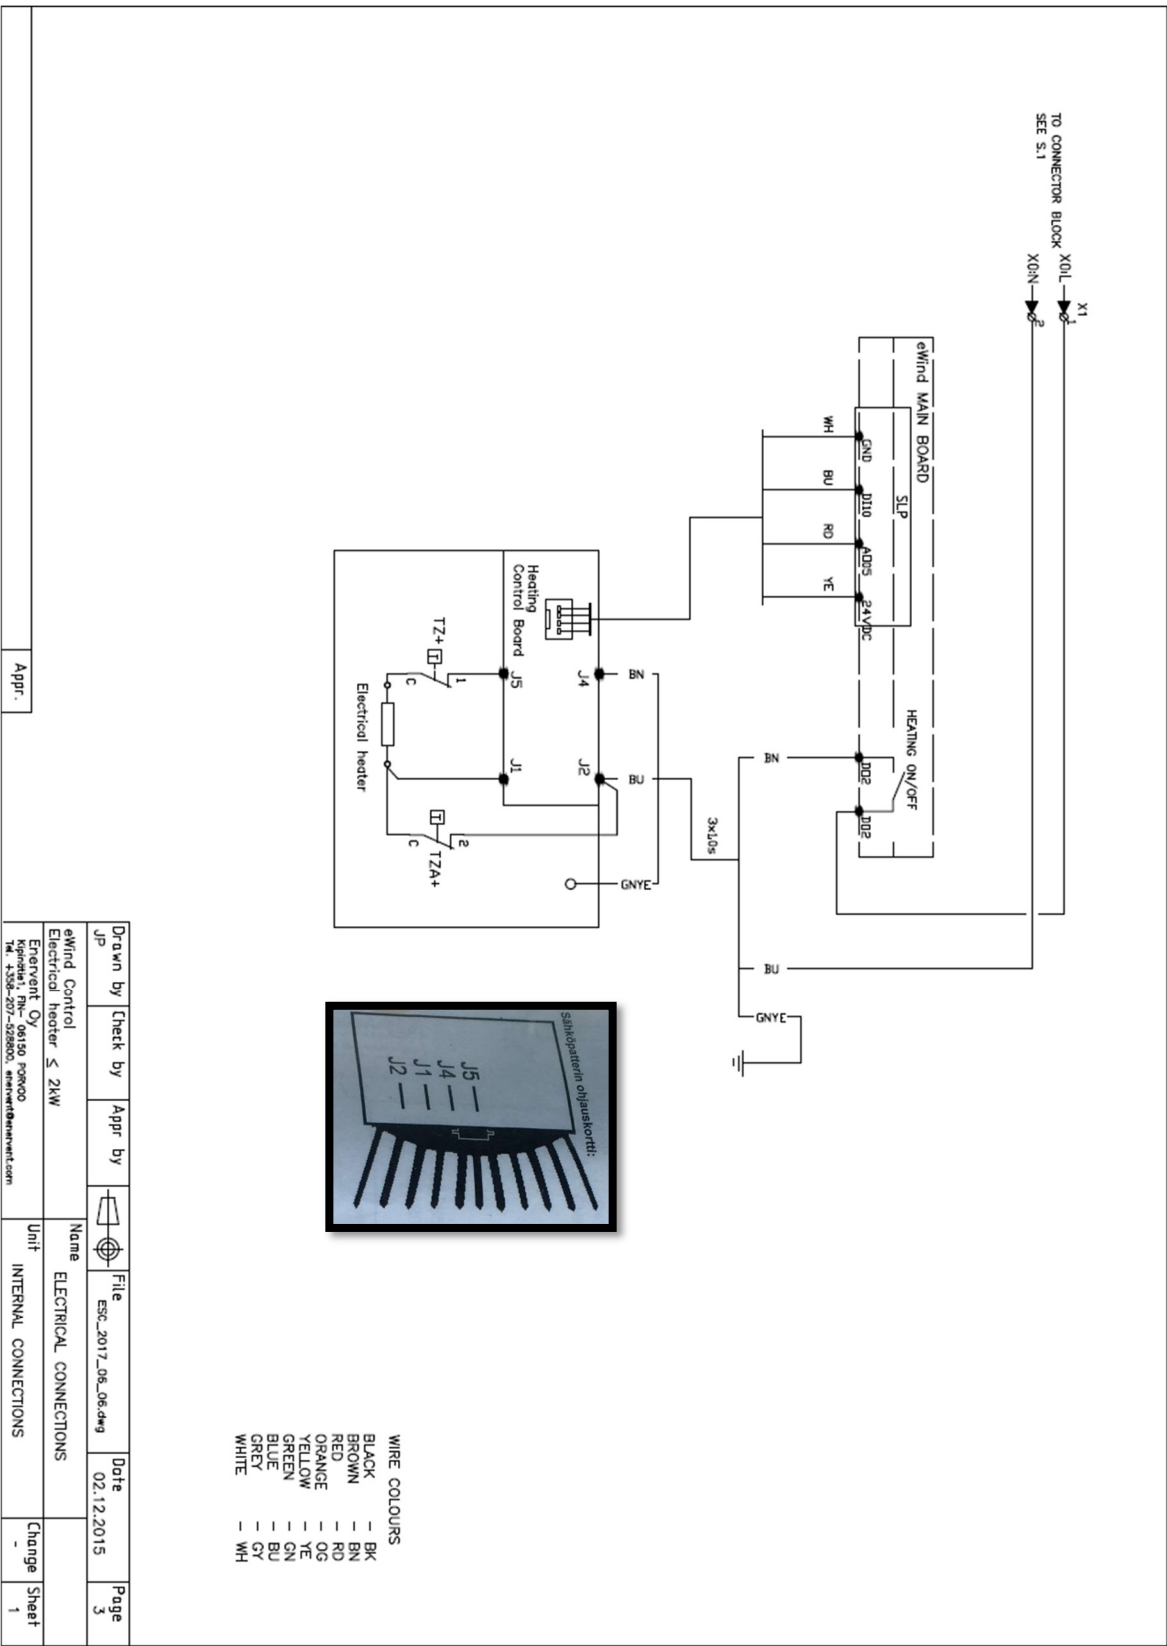

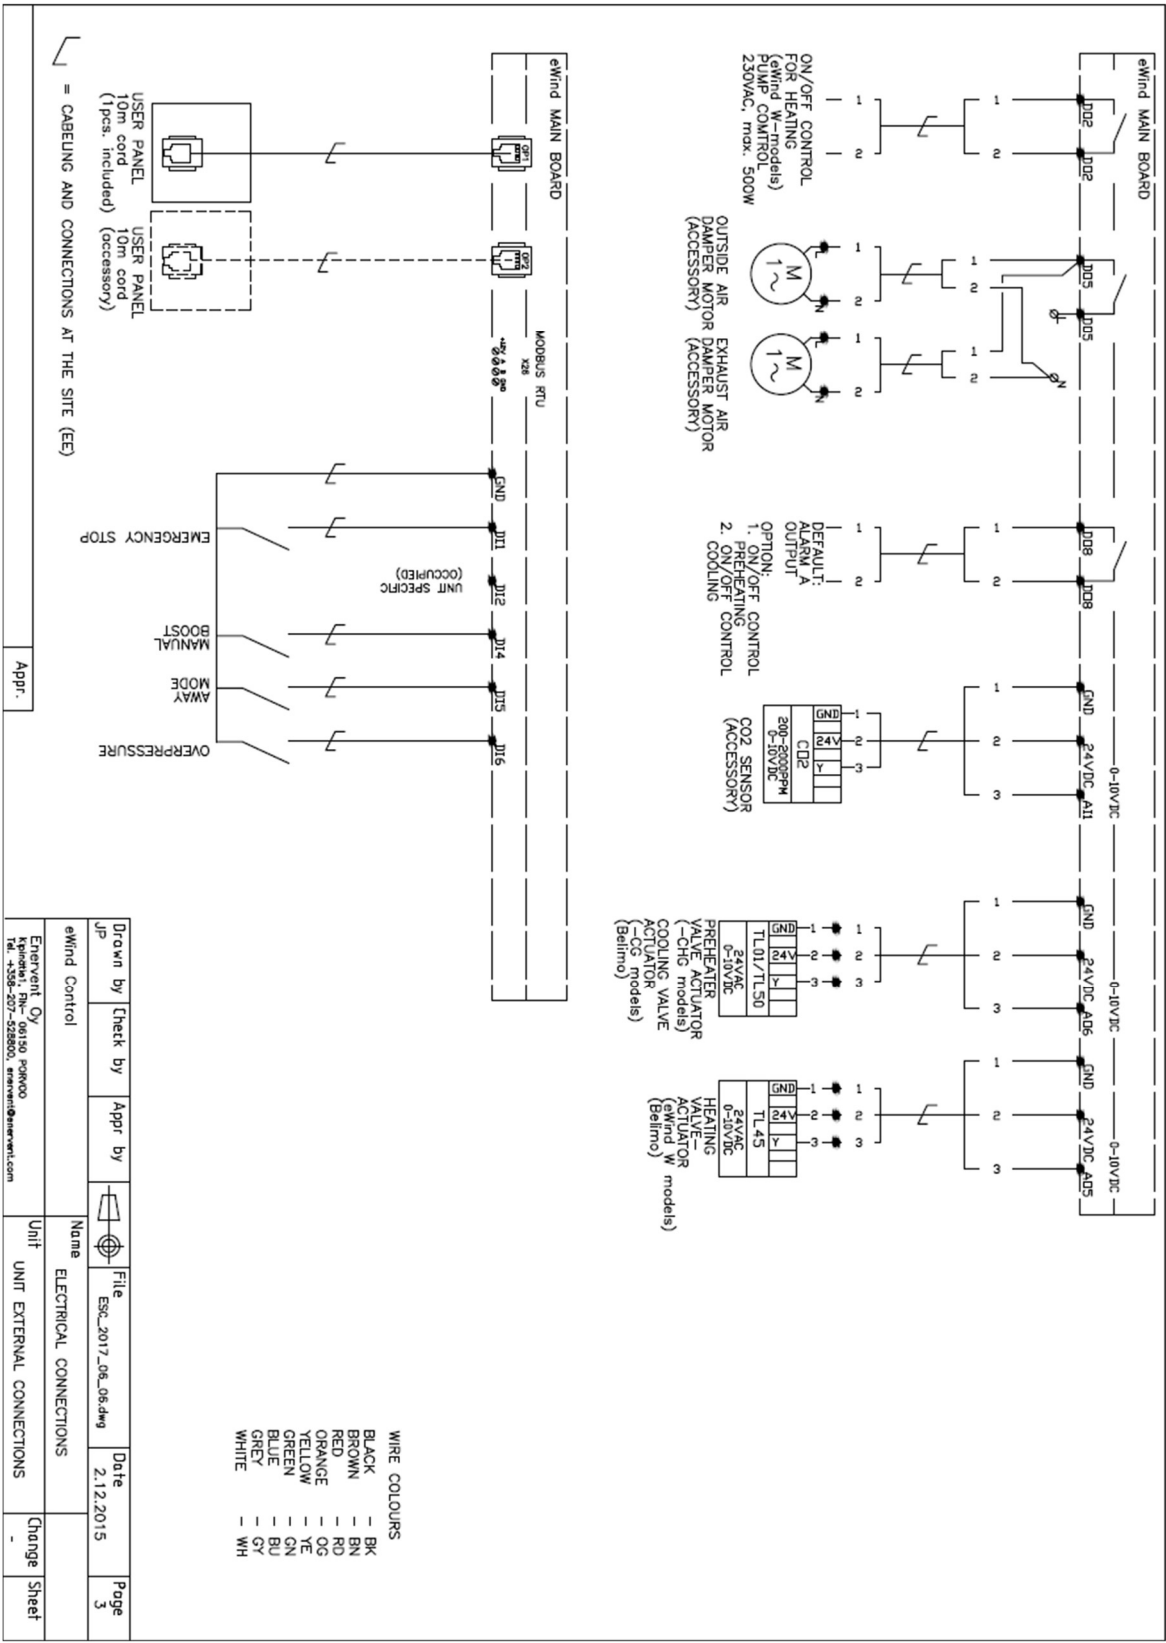

MANDATORY PARTS

10024026	CONTROL UPDATE KIT LTR3 ACE/ECE → EWIND E	1
10023157	FAN PACKAGE ECO 118W	2
10023290	ELECTRICAL HEATER 0,5kW	1

Code	Description	Pcs.
10024026	CONTROL UPDATE KIT LTR3 ACE/ECE → EWIND E	

Automation

40029189	Control board EM-240-M	1
40030936	PCB support KGLS-6S	4
40030937	PCB support LCBSM-6-01	4
40031695	Screw DIN 7981 ZN 3,9x9,5	4
40031631	Screw DIN 7985 ZN M4x20	1
40031537	Washer 6798-A ZN M4x8	3
40031489	Nut DIN 934/B ZN M4	1
40028772	Wire 65mm orange 0,75mm ²	1
40028773	Wire 340mm orange 0,75mm ²	5
40028774	Wire 255mm 1mm ² black	1
40028779	Wire 255mm 1mm ² blue	1
40031094	eWind main board	1
40029195	Power supply Tufvassons PSLR24	1
40028788	Ground wire 100mm	1
40029341	Terminal SL 4/15	1
40029343	Terminal ES 15 PA	1
40029340	Terminal SRK 2,5/15 PA	2
40029330	Terminal marking PMC SB 5/50 So ERDE	1
40029329	Terminal marking PMC SB 5/50 So L	1
40029327	Terminal marking PMC SB 5/50 FW N	1
40029647	Automation base	1

Components

40030100	Cable sealing VET 5-7	10
40029244	Cable sealing PMR 615 AVL140	8
40028782	Fan power cable supply air	1
40028803	Fan power cable extract air	1
40028784	Fan control cable supply air	1
40028802	Fan control cable extract air	1
40029167	EDA temperature sensor 1700mm	2
40029165	EDA temperature sensor 850mm	2
40029223	Humidity/temperature sensor Amphenol 350mm	1
40029982	Connection terminal WaGo 221-415	2
40031530	Screw ZN 4,2x25	4
40028776	Wire 250mm black (wire with flat connector)	2
40028777	Wire 250mm blue (wire with flat connector)	2
40028774	Wire 255mm 1mm ² black	1
40031537	Washer 6798-A ZN M4x8	1
40031489	Nut DIN 934/B ZN M4	1
40030997	Cable tie 2,5x200mm	10
40028737	HRW motor package stepless DC	1
40033952	Rotor cable DC 105cm	1
40031115	eWind panel package	1
40034288	WiFi module package	1

Manuals etc. (depends on model)

eWind installation manual	1
eWind user manual	1
eWind electrical diagrams	1

Notes: